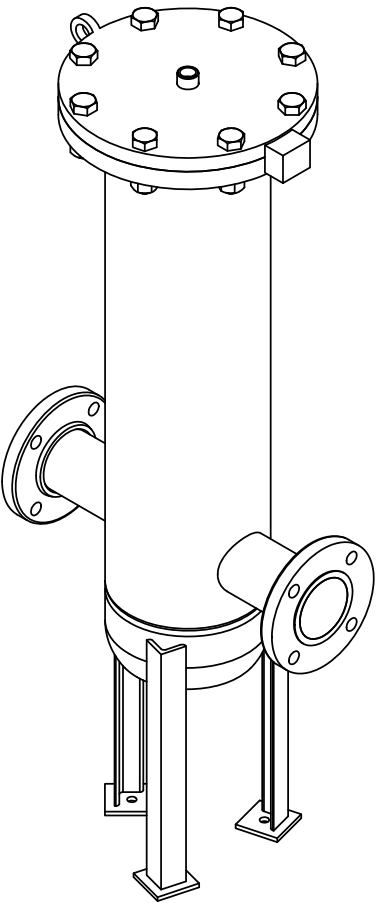
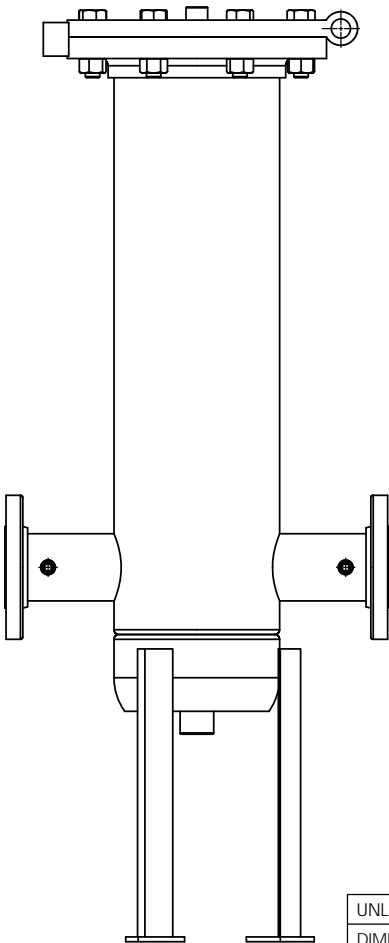
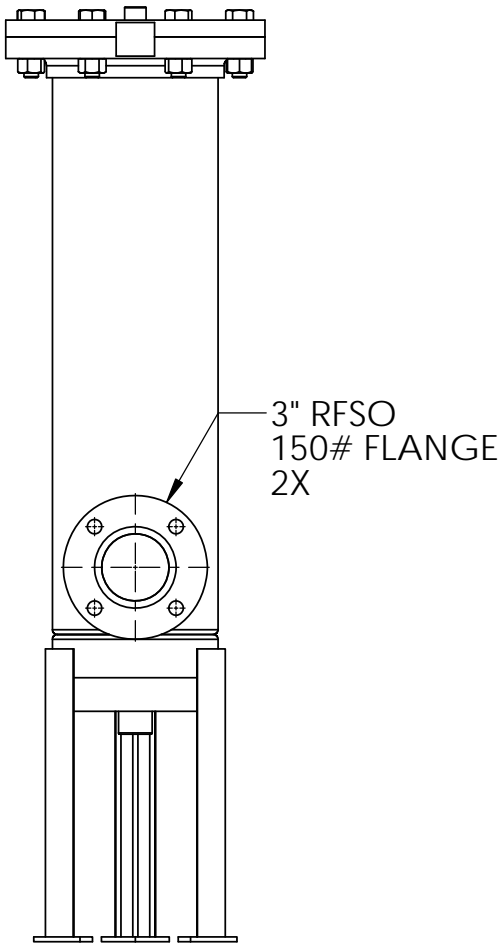
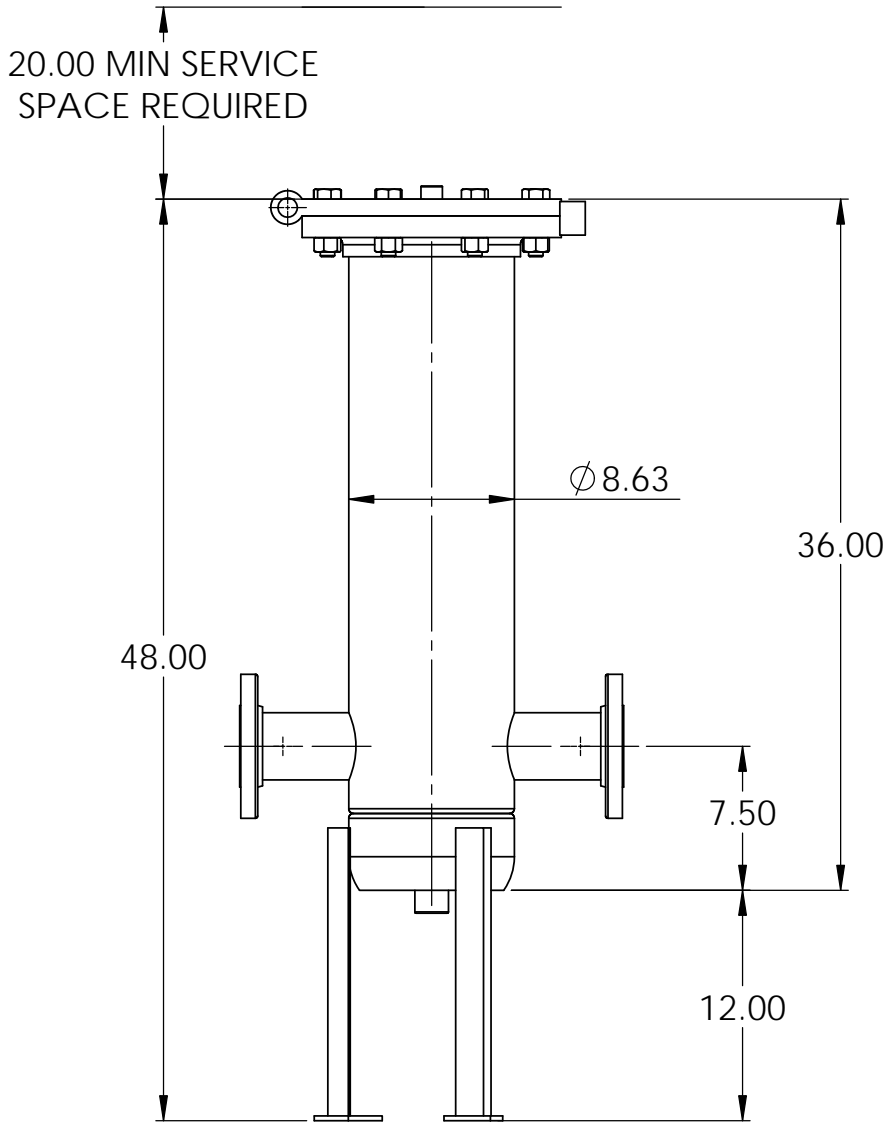




**NOTES:**  
DESIGNED, WELDED, INSPECTED TO ASME CODE  
SECTION VIII DIV 1, U STAMP WITH NB  
REGISTRATION 285 PSIG @ -20 TO +100 DESIGN  
HYDRO TEST-428 PSIG  
CS CONSTRUCTION (EXCEPT AS NOTED)  
3" 150# RFSO CONNECTIONS  
1/2" NPT VENT  
1/2" NPT DRAIN CONNECTION  
1/4" NPT GAUGE CONNECTION  
INTERNAL FINISH: WHITE ENAMEL  
EXTERNAL FINISH: AIRCEL BLUE ENAMEL

REPLACEMENT ELEMENT: AG3040093  
FILTER MEDIA: FIBERGLASS FILTER JACKETS; 0.3  $\mu$  RETENTION  
UPSTREAM/DOWNSTREAM FILTER JACKETS  
PERFORATED CORE



UNLESS OTHERWISE SPECIFIED:		NAME		DATE		 <div>COMPRESSED AIR AND GAS PRODUCTS 323 CRISP CIRCLE MARYVILLE TENNESSEE 37801 PHONE: 865-681-7066 FAX: 865-681-7069</div>					
DIMENSIONS ARE IN INCHES		DRAWN	O.P.	05/02/19		TITLE:  MIS-1000, 3IN FLG CONN					
TOLERANCES:		CHECKED	M.S.	05/02/19							
FRACTIONAL ± 0.125		ENG APPR.									
ANGULAR: ±0.5°		MFG APPR.									
TWO PLACE DECIMAL ± .03		Q.A.									
THREE PLACE DECIMAL ± .003		COMMENTS:				SIZE <b>B</b>		DWG. NO.  AG3040084		REV  <b>0</b>	
											
THIRD ANGLE PROJECTION											
MATERIAL											
FINISH											
DO NOT SCALE DRAWING						SCALE: 1:10		WEIGHT:		SHEET 1 OF 1	

**PROPRIETARY AND CONFIDENTIAL**  
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF  
AIRCEL LLC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE  
WRITTEN PERMISSION OF AIRCEL LLC IS PROHIBITED.